



Preliminary Results of Advanced Heuristic Optimization in the Risk-based Energy Scheduling Competition

José Almeida, Fernando Lezama, João Soares, Zita Vale, Bruno Canizes

{jorga, flz, jan, zav, bmc}@isep.ipp.pt

GECAD Research Center, Polytechnic of Porto
Porto, Portugal

ABSTRACT

In this paper, multiple evolutionary algorithms are applied to solve an energy resource management problem in the day-ahead context involving a risk-based analysis corresponding to the proposed 2022 competition on evolutionary computation. We test numerous evolutionary algorithms for a risk-averse day-ahead operation to show preliminary results for the competition. We use evolutionary computation to follow the competition guidelines. Results show that the HyDE algorithm obtains a better solution with lesser costs when compared to the other tested algorithm due to the minimization of worst-scenario impact.

CCS CONCEPTS

• **Computing methodologies** → *Search methodologies*; • **Applied computing** → **Engineering**.

KEYWORDS

Energy resource management, evolutionary computation, optimization, risk analysis

1 INTRODUCTION

The current goals set to decrease the carbon footprint, mainly in the European Union, which are set to reduce emissions of at least 55% by 2030 [1], encourage the integration of distributed energy resource (DER) in the smart grid paradigm. This high penetration increase poses new challenges to the correct operation of the electricity grid because of the uncertainty characteristic of these resources. The energy resource management (ERM) problem considering uncertainty is introduced here to achieve a proper operation of the energy management system.

Considering the variability and uncertainty of the considered technologies like renewable generation such as photovoltaic (PV) and wind (weather dependent), EV travel behavior, load consumption, and electricity market prices, we introduce the concept of extreme event day-ahead operation problem. As the name indicates, an extreme event is an occurrence that is of low probability because it is something improbable to occur, but that can cause a high impact on the energy management system, making the obtained

solution volatile. The existence of these events creates a risk associated with the ERM problem. In this situation, we incorporate two risk measuring tools: value-at-risk (VaR) and conditional VaR (CVaR) to evaluate the risk associated with the day-ahead management solution for a given number of scenarios [2]. The CVaR measuring tool is utilized in comparison to the mean-variance tool, because the CVaR analysis is not limited to an elliptical probability distribution as referenced in [3], and a gaussian distribution can be used as we propose in this paper.

Traditional optimization algorithms have struggled to keep up with the increasing complexity in several scientific disciplines. Alternative methodologies, such as evolutionary computation (EC), are a possible choice in this circumstance [4]. Due to the complexity presented in most energy optimization problems, which involve the ERM problem, EC is a powerful tool well suited to be applied to solve this problem [5].

This paper is based on [6] which proposed a robust ERM including CVaR risk analysis. The optimization problem is mixed-integer linear programming (MILP) and was solved using evolutionary algorithms (EAs) considering risk-neutral and risk-averse approaches. This work focuses on the "Competition on Evolutionary Computation in the Energy Domain: Risk-based Energy Scheduling¹," which only considers a total risk aversion in the optimization, and fewer scenarios are evaluated with fewer extreme events being created. Different EAs are used from the one previously, including differential evolution (DE), hybrid-adaptive DE with decay function (HyDE-DF) [7], vortex search (VS) [8], particle swarm optimization (PSO), success-history based adaptive DE (SHADE) [9], and L-SHADE [10]. These algorithms are used, because the basis of the competition is the application of EC in the energy domain. Numerous research has demonstrated the efficacy of these algorithms in addressing benchmark issues and real-world applications. The proposed ERM framework for the competition can be seen in Figure 1.

2 RISK-BASED METHODOLOGY

Regarding the risk-based methodology, this section presents the mathematical formulation for the ERM model present in the proposed competition considering multiple EC optimization techniques.

2.1 Risk formulation

The proposed day-ahead optimization problem consists in a cost minimization given by:

$$\min \text{Cost} = z^{\text{ExCost}} + \text{CVaR}_\alpha \quad (1)$$

¹<http://www.gecad.isep.ipp.pt/ERM-competitions/2022-2/>

Permission to make digital or hard copies of all or part of this work for personal or classroom use is granted without fee provided that copies are not made or distributed for profit or commercial advantage and that copies bear this notice and the full citation on the first page. Copyrights for components of this work owned by others than ACM must be honored. Abstracting with credit is permitted. To copy otherwise, or republish, to post on servers or to redistribute to lists, requires prior specific permission and/or a fee. Request permissions from permissions@acm.org.

GECCO '22 Companion, July 9–13, 2022, Boston, MA, USA

© 2022 Association for Computing Machinery.

ACM ISBN 978-1-4503-9268-6/22/07...\$15.00

<https://doi.org/10.1145/3520304.3535080>

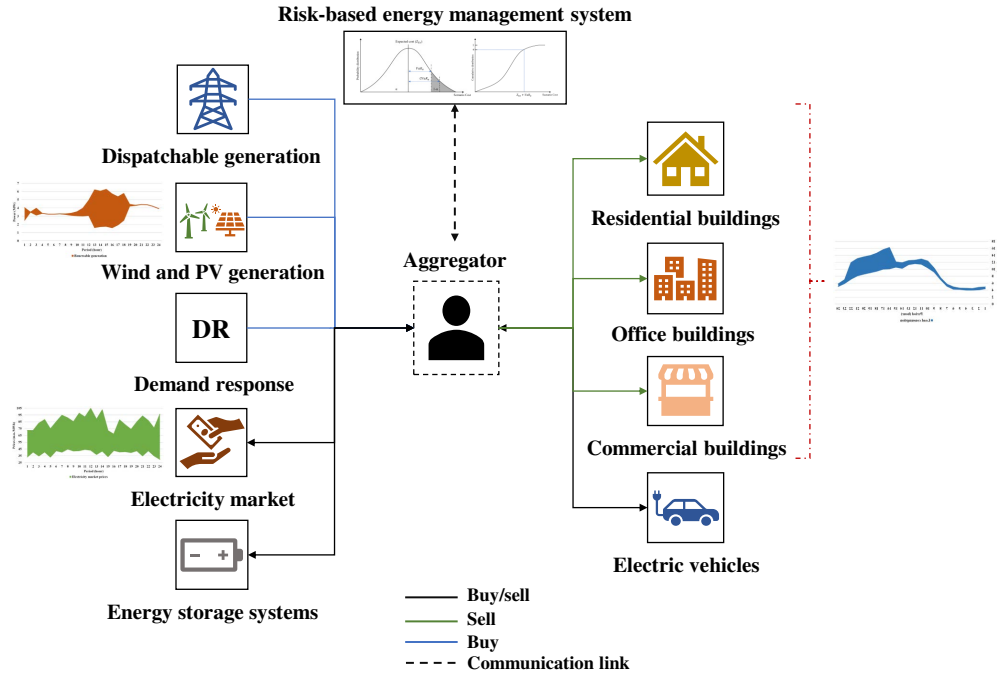


Figure 1: Considered ERM with risk evaluation.

where the expected cost (z^{ExCost}), and CVaR_α are given by:

$$z^{\text{ExCost}} = \sum_s^{N_s} z_s^{\text{Cost}} \times \rho_s \quad (2)$$

$$\text{CVaR}_\alpha(z_s^{\text{Cost}}) = \text{VaR}_\alpha(z_s^{\text{Cost}}) + \frac{1}{1-\alpha} \sum_{s=1}^{N_s} \rho_s \times \pi_s \quad (3)$$

where:

$$\text{VaR}_\alpha(z_s^{\text{Cost}}) = z - \text{score}(\alpha) * \text{std}(z_s^{\text{Cost}}) \quad (4)$$

where z_s^{Cost} are the costs associated with each scenario, ρ_s represents the scenario probability, α is the confidence level, and π_s are the worst scenario costs. That is the costs of the scenarios that exceed the confidence level. $z - \text{score}(\alpha)$ computes the cumulative distribution function. The formulation for z_s^{Cost} can be expressed as:

$$z_s^{\text{Cost}} = z_s^{\text{OC}} - z_s^{\text{MT}} + BV_s \quad (5)$$

where z_s^{OC} are the operational costs of each scenario, z_s^{MT} are the revenues from market transactions, and BV_s is the bound violation penalty.

The remaining formulations for the operational costs, market transactions and problem constraints can be seen in [6].

A risk-averse approach analyzes the risk associated with the considered technologies' (renewables, load, market prices, etc) uncertainty. In $(1-\alpha)$ of the scenarios with the highest costs that exceed the confidence level, the additional cost of CVaR_α is added in Eq. 1.

2.2 Metaheuristic optimization

To tackle the complex energy problem that is the ERM, multiple CI optimization methods were used. Each metaheuristic randomly generates an initial solution between variables' upper and lower bounds. For each of the 24 periods, each solution is comprised of a series of sequentially repeated variables.

The risk-based scheduling methodology's optimization procedure aims to reduce the costs in Eq.1 by minimizing the impact of extreme events. The fitness function represented in Figure 2 begins by importing the initial metaheuristic solution, the case study comprising all created scenarios (a total of 15 scenarios), where some contain extreme occurrences such as market price increase, load increase, and renewable generation reduction due to weather variability. In the proposed methodology, we considered a total risk aversion, so there is no need to set up a risk aversion variable that can vary from 0 to 100% as shown in [6]. The following step is the fitness evaluation that calculates all the scenario costs regarding the proposed day-ahead ERM problem formulations. After that, the function calculates all the risk measuring parameters as presented in section 2.1.

The output of this function is the fitness value which is the cost to be minimized by each metaheuristic.

The ERM under consideration includes 13,680 variables per individual, distributed across 570 variables per period, with 21 variables forming the generators' active power and 21 binary variables indicating the generators' status. A total of 500 EVs were integrated, with 25 different load types, two energy storage systems, and one wholesale electricity market.

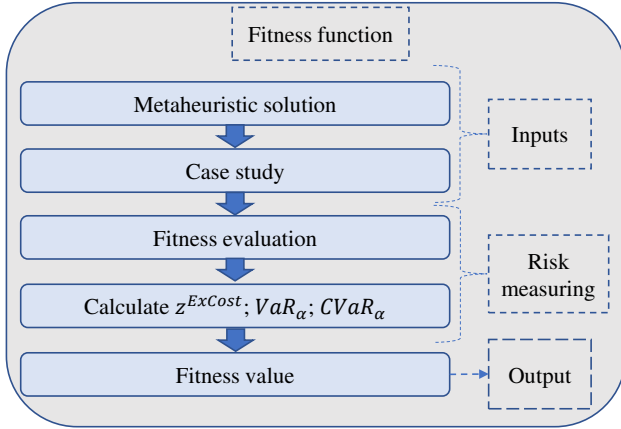


Figure 2: Fitness function framework.

3 RESULTS

This section presents the case study and obtained results regarding the risk-based results in terms of aggregator's costs and algorithm performance of each EA for the proposed methodology.

3.1 Case Study

This case study was conducted on a distribution network of a smart grid located in the BISITE laboratory at the University of Salamanca, Spain [11], where an external supplier (30MVA substation) is situated at bus 1. A 27% renewable generation was considered with a 24% wind and 3% PV penetration. This network includes 25 different loads in terms of consumption, including residential and office buildings, as well as some service buildings such as an hospital, fire station, and shopping mall.

High integration of electric vehicles (EVs) was considered with a total of 500 EVs, where EV uncertainty was modeled using an EV travel behavior simulator tool proposed in [12]. Multiple classes of vehicles were employed, with two types of EVs: battery EVs and plug-in hybrid EVs, each with its own set of features, as described in [13].

A total of 5000 scenarios were initially generated using the Monte Carlo Simulation, but were reduced to 15 scenarios to reduce computation time and effort. The risk scenarios generated by the aggregator's variable inputs exhibit much variation. In this setting, variations in load demand and renewable generation can be observed. Figure 3 shows the total variation in electricity market, and external supplier prices. Due to the multiple extreme scenarios that consider an increase in market costs, there is a significant variation in market prices. Period 12 has a maximum value of 104.61 m.u., with a lowest value of 43.36 m.u., indicating a significant rise of 61.25 m.u. External supplier costs have only two values fixed at 50 m.u. during off-peak hours (lower energy costs) and 90 m.u. during peak hours (higher energy costs).

The aggregator's total load demand and renewable generation are represented in Figure 4. From the extreme events generated, significant variance in load can be seen from periods 16 to 22, with the highest value of 16.20 MW in period 16. Since some extreme events

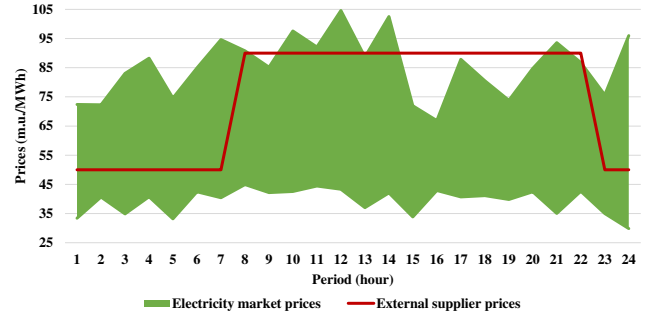


Figure 3: Wholesale electricity market and external supplier prices variation curves.

generated involve a reduction in renewable generation, mainly PV, the variations are modest in some periods, while a higher fluctuation may be seen in periods 13 to 18, where still PV generation is the highest.

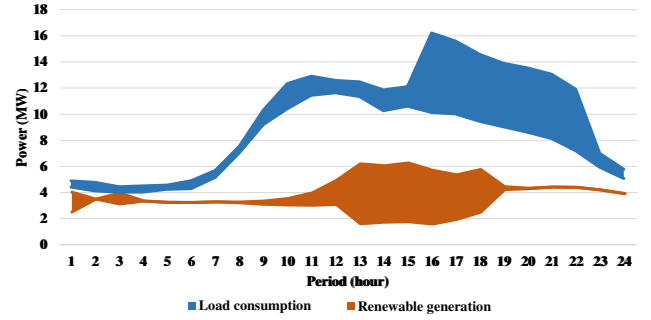


Figure 4: Load consumption and renewable generation variation curves.

Numerous metaheuristics were applied to solve the proposed ERM model considering risk analysis, and Table 1 illustrates the parameters used for each considering the competition rules of a total of 5,000 function evaluations (FEs). Therefore, we set the maximum generation (GEN) number and population size (NP) to 500 and 10, respectively. For the PSO algorithm, multiple parameters are needed as the personal cognitive coefficient (c1), the global cognitive coefficient (c2), minimum and maximum inertia weights (Wmin and Wmax), and particle velocity factor (V) to establish velocity limits. The scaling factor (F) and crossover probability (Cr) are set for the algorithms based on DE.

3.2 Risk-based results

The average results obtained by the applied EAs for the ERM problem considering CVaR risk measuring are described in Table 2 for a total of 20 trials. The table shows the average fitness values obtained for each EA, which in this case corresponds to the objective function costs, where HyDE presents the lowest values compared to the other algorithms because of the worst scenario and penalty cost reduction. HyDE was able to reduce 30.30% of worst scenario costs compared to the next best algorithm (HyDE-DF), corresponding to


Table 1: Parameter of each EA.

EA	GEN	NP	c1	c2	Wmin	Wmax	V	F	Cr
PSO			1.5	2	0.4	0.9	0.1	-	-
DE									
HyDE								0.3	0.5
HyDE-DF	500	10							
VS					-			-	-
SHADE								0.5	0.5
L-SHADE									

a 28.73% in costs/fitness reduction. PSO was the fastest algorithm regarding the optimization time, followed by DE.

For a total of 15 scenarios generated for the case study Table 3 shows the average and standard deviation scenario costs, demonstrating the discrepancy between all the scenarios. Since HyDE obtained the best fitness value due to the worst scenario cost reduction, it was expected that this algorithm also obtained the lowest scenario costs, as the table shows. When it comes to the average scenario costs HyDE reduced 3,547 m.u. compared to HyDE-DF, which was the following algorithm with the lowest costs.


The average risk measuring costs given by the CVaR variable are presented in Figure 5. It can be seen that HyDE, HyDE-DF, and VS are the only algorithms that offer a lesser value than the average CVaR, with the remaining showing greater values. That is, the remaining algorithms give a more volatile solution with the costs associated with the worst scenarios being elevated (Table 2) due to the extreme events. This situation means that these EAs fail to minimize these events' impact on the ERM solution. For example, HyDE reduced 81.59% of CVaR costs compared to the average value, and SHADE presented 37.59% of higher CVaR costs from the average value.

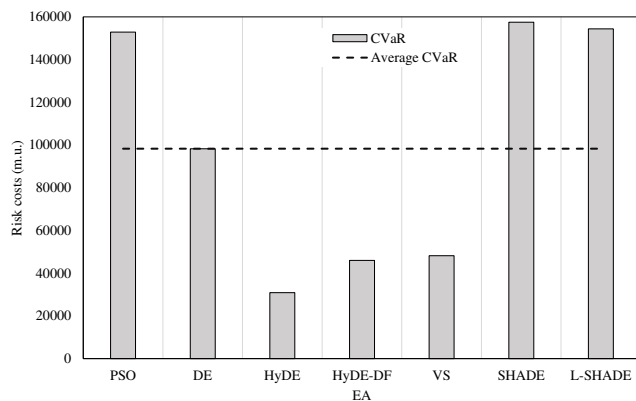**Figure 5: CVaR costs achieved by each tested EA.**

3.3 Algorithm Performance

For the proposed optimization model, the EAs' performance was assessed for a total of 20 runs. The convergence of each algorithm is shown in Figure 6. From all the tested algorithms, it can be seen that HyDE presents the best performance achieving the lowest

fitness value, with HyDE-DF and VS following. PSO, SHADE, and L-SHADE present similar convergences, with SHADE presenting the worst fitness values and are most likely stuck in local minima due to the fast convergence.

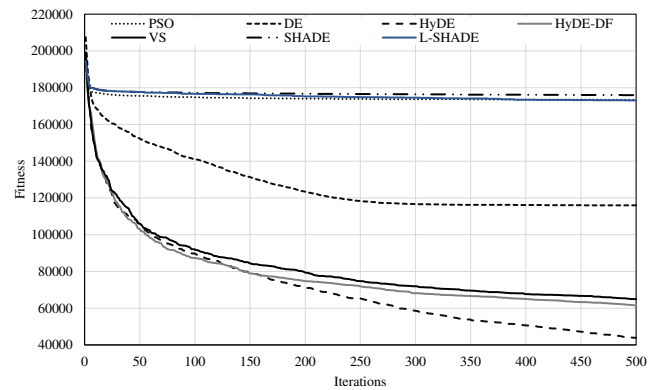**Figure 6: Convergence of the tested EAs.**

A Wilcoxon test was performed on the risk-based results obtained with a significance level of 5%. As HyDE presented the best cost results, the statistical test was conducted using HyDE as the base algorithm for comparison, as Table 4 shows. The table shows four results: R+, R-, p-value, and L-sign. The R+ and R- to the total of positive and negative ranks that show the base algorithm's performance compared to the other algorithms. As expected, HyDE consistently outperformed the compared algorithms. The p-value demonstrates how significant the difference is, as the obtained p-values are more than the 5%. Finally, the L-sign is the sign (+, -, =) representing the statistical performance attained, where HyDE for the proposed problem obtained the best statistical performance.

HyDE, provides exceptional outcomes because of the self-adaptive processes like jDE [14]. It also makes use of perturbations inspired by EPSO [15], which have been shown to increase the algorithms' convergence while tackling optimization problems in the energy domain.

4 CONCLUSIONS

In this paper, we verified the application of multiple EAs to the proposed risk-based ERM competition. The risk associated with extreme events was evaluated through the CVaR mechanism for a 100% risk-averse formulation.

Table 2: Average costs, expected costs, worst scenario, penalties, and computational time obtained by each EA (random).

EA	Cost/fitness (m.u.)	z^{ExCost} (m.u.)	Worst scenario (m.u.)	penalties (m.u.)	time (min)
PSO	173,369	20,526	208,462	6,875	5.23
DE	116,007	17,779	138,517	4,565	5.27
HyDE	43,881	12,966	49,654	1,850	6.10
HyDE-DF	61,571	15,564	71,235	3,272	6.14
VS	64,959	16,776	75,004	4,260	6.11
SHADE	175,956	18,482	212,184	7,087	5.29
L-SHADE	173,071	18,711	208,582	6,955	5.31

Table 3: Average and standard deviation scenario costs for each EA.

EA	Avg. Scenario Costs (m.u.)	Std. Scenario Costs (m.u.)
PSO	28,006	50,252
DE	22,708	32,348
HyDE	15,256	11,002
HyDE-DF	18,803	16,205
VS	20,170	17,009
SHADE	25,786	51,570
L-SHADE	25,856	50,667

Table 4: Wilcoxon signed rank test.

HyDE vs.	R+	R-	p-value	L-sign
PSO	210	0	1.91E-06	+
DE	210	0	1.91E-06	+
HyDE-DF	207	3	9.54E-06	+
VS	208	2	5.72E-06	+
SHADE	210	0	1.91E-06	+
L-SHADE	210	0	1.91E-06	+

The preliminary results for the 2022 competition show that the HyDE algorithm achieved both the lowest CVaR and total day-ahead costs compared to the other algorithms, even an improved version such as HyDE-DF. Because HyDE could reduce the worst scenario costs majorly. This was further proved by the implemented Wilcoxon signed rank test. Different DE algorithms SHADE and L-SHADE together with PSO showed similar, but poor performances for this problem, achieving the highest aggregated day-ahead costs.

ACKNOWLEDGMENTS

This research has received funding from FEDER funds through the Operational Programme for Competitiveness and Internationalization (COMPETE 2020), under Project POCI-01-0145-FEDER-028983; by National Funds through the FCT Portuguese Foundation for Science and Technology, under Projects PTDC/EEI-EEE/28983/2017 (CENERGETIC), CEECIND/02814/2017, UIDB/000760/2020, and UIDP/00760/2020.

REFERENCES

- [1] European Commission. Fit for 55 - Delivering the EU's 2030 climate target on the way to climate neutrality. *European Commission*, page 15, 2021.
- [2] P. Beraldi, A. Violi, G. Carrozzino, and M.E. Bruni. A stochastic programming approach for the optimal management of aggregated distributed energy resources. *Computers & Operations Research*, 96:200–212, August 2018.
- [3] Panna Miskolczi. DIFFERENCES BETWEEN MEAN-VARIANCE AND MEAN-CVAR PORTFOLIO OPTIMIZATION MODELS. page 10, 2016.
- [4] João Soares, Tiago Pinto, Fernando Lezama, and Hugo Morais. Survey on Complex Optimization and Simulation for the New Power Systems Paradigm. *Complexity*, 2018:1–32, August 2018.
- [5] Fernando Lezama, Luis Enrique Sucar, Enrique Munoz de Cote, João Soares, and Zita Vale. Differential evolution strategies for large-scale energy resource management in smart grids. In *Proceedings of the Genetic and Evolutionary Computation Conference Companion*, pages 1279–1286, Berlin Germany, July 2017. ACM.
- [6] Jose Almeida, Joao Soares, Fernando Lezama, and Zita Vale. Robust Energy Resource Management Incorporating Risk Analysis Using Conditional Value-at-Risk. *IEEE Access*, 10:16063–16077, 2022.
- [7] Fernando Lezama, João Soares, Ricardo Faia, and Zita Vale. Hybrid-adaptive differential evolution with decay function (HyDE-DF) applied to the 100-digit challenge competition on single objective numerical optimization. In *Proceedings of the Genetic and Evolutionary Computation Conference Companion*, pages 7–8, Prague Czech Republic, July 2019. ACM.
- [8] Berat Doğan and Tamer Ölmez. A new metaheuristic for numerical function optimization: Vortex Search algorithm. *Information Sciences*, 293:125–145, February 2015.
- [9] Ryoji Tanabe and Alex Fukunaga. Success-history based parameter adaptation for Differential Evolution. In *2013 IEEE Congress on Evolutionary Computation*, pages 71–78, Cancun, Mexico, June 2013. IEEE.
- [10] Ryoji Tanabe and Alex S. Fukunaga. Improving the search performance of SHADE using linear population size reduction. In *2014 IEEE Congress on Evolutionary Computation (CEC)*, pages 1658–1665, Beijing, China, July 2014. IEEE.
- [11] Bruno Canizes, João Soares, Zita Vale, and Juan Corchado. Optimal Distribution Grid Operation Using DLMP-Based Pricing for Electric Vehicle Charging Infrastructure in a Smart City. *Energies*, 12(4):686, February 2019.
- [12] João Soares, Bruno Canizes, Cristina Lobo, Zita Vale, and Hugo Morais. Electric Vehicle Scenario Simulator Tool for Smart Grid Operators. *Energies*, 5(6):1881–1899, June 2012.
- [13] Jose Almeida, Joao Soares, Bruno Canizes, Fernando Lezama, Mohammad Ali Ghazvini Fotouhi, and Zita Vale. Evolutionary Algorithms for Energy Scheduling under uncertainty considering Multiple Aggregators. In *2021 IEEE Congress on Evolutionary Computation (CEC)*, pages 225–232, Kraków, Poland, June 2021. IEEE.
- [14] Janez Brest, Sao Greiner, Borko Boskovic, Marjan Mernik, and Viljem Zumer. Self-Adapting Control Parameters in Differential Evolution: A Comparative Study on Numerical Benchmark Problems. *IEEE Transactions on Evolutionary Computation*, 10(6):646–657, December 2006.
- [15] V. Miranda and N. Fonseca. EPSO-evolutionary particle swarm optimization, a new algorithm with applications in power systems. In *IEEE/PES Transmission and Distribution Conference and Exhibition*, volume 2, pages 745–750, Yokohama, Japan, 2002. IEEE.